





Understanding grease removal and the 25% rule

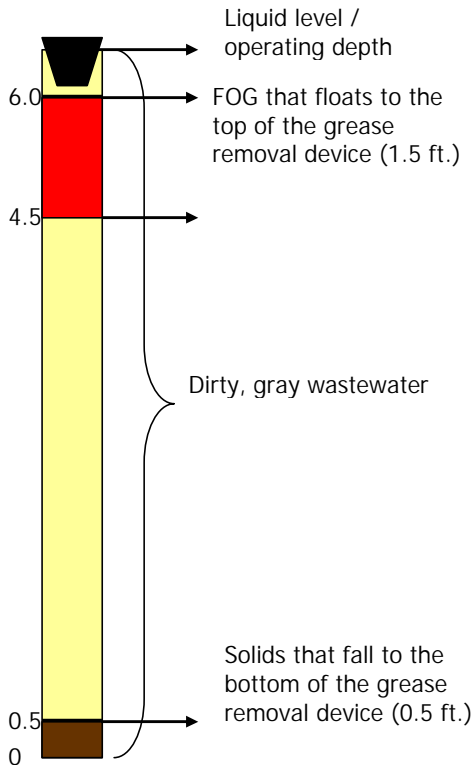

Per City Ordinance, all food service establishments must have grease removal devices maintained by a certified grease hauler when they reach 25% of the design capacity OR a minimum of quarterly. Please contact your service provider or the WRA with any questions.

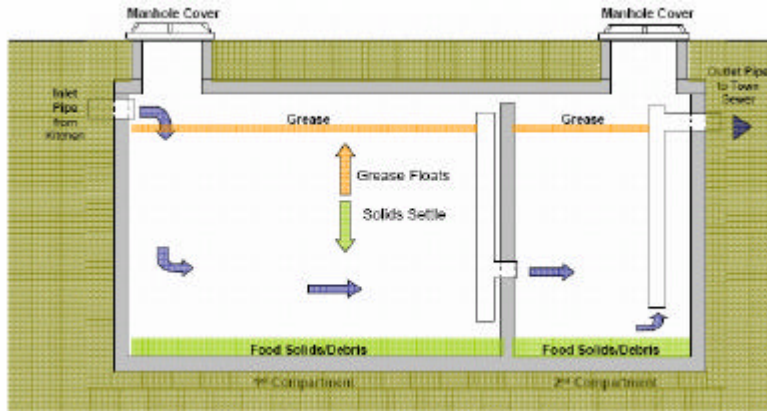

- Does this example meet the 25% rule?
 - Total FOG on top of interceptor = 1.5 ft.
 - Total solids at bottom of interceptor = 0.5 ft.
 - Total height of interceptor contents = 6 ft.
- Percentage of FOG + solids:
 - $(\text{total FOG} + \text{solids}) / \text{total height of interceptor contents} = X$
 - $X = 33\%$
 - Answer: No, the 25% rule is not met and the FSE needs to increase pumping frequency.
- The certified grease hauler you employ has been trained by the WRA to assist you with an appropriate cleaning schedule.

Des Moines Metro Wastewater Reclamation Authority
 3000 Vandalia Road
 Des Moines, IA 50317
 (515) 323-8000
www.dmmwra.org